


made of grade 304 stainless steel - grade 316 on request

Floor drains with square top plate and vertical outlet,
removable Total Hygienic internal odor trap pipe and filter basket.

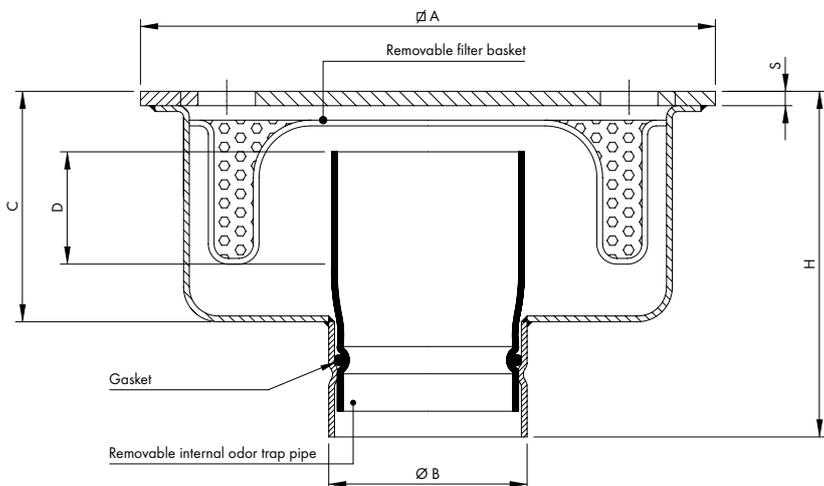


Dwg. No. 0116

| Article | DIMENSIONS in mm | | | | | | FLOW RATE | | LOAD CAPACITY IN Kg | |
|---------------|------------------|---|------|-----|----|-----|-----------|-------------|---------------------|-------|
| | Ø A | S | Ø B* | C | D | H | with Kit | without kit | LOAD | LOAD |
| R-low profile | | | | | | | | | | |
| R 75 V 206 E | 200 | 6 | 75 | 70 | 20 | 140 | 60 | 120 | 1000 | 10000 |
| 75 V 206 E | 200 | 6 | 75 | 110 | 50 | 180 | 60 | 120 | 1000 | 10000 |
| R 75 V 308 E | 300 | 8 | 75 | 65 | 20 | 140 | 80 | 240 | 1000 | 10000 |
| 75 V 308 E | 300 | 8 | 75 | 110 | 50 | 180 | 80 | 240 | 1000 | 10000 |
| R 110 V 308 E | 300 | 8 | 110 | 65 | 20 | 170 | 135 | 340 | 1000 | 10000 |
| 110 V 308 E | 300 | 8 | 110 | 110 | 50 | 210 | 135 | 340 | 1000 | 10000 |

* Outlet Ø 63 mm available on request.
N.B. water seal depth (dimension D) of 50 mm in compliance with standard UNI EN 1253-1



Floor drains with square top plate and horizontal outlet,
removable TotalHygienic internal odor trap pipe and filter basket.

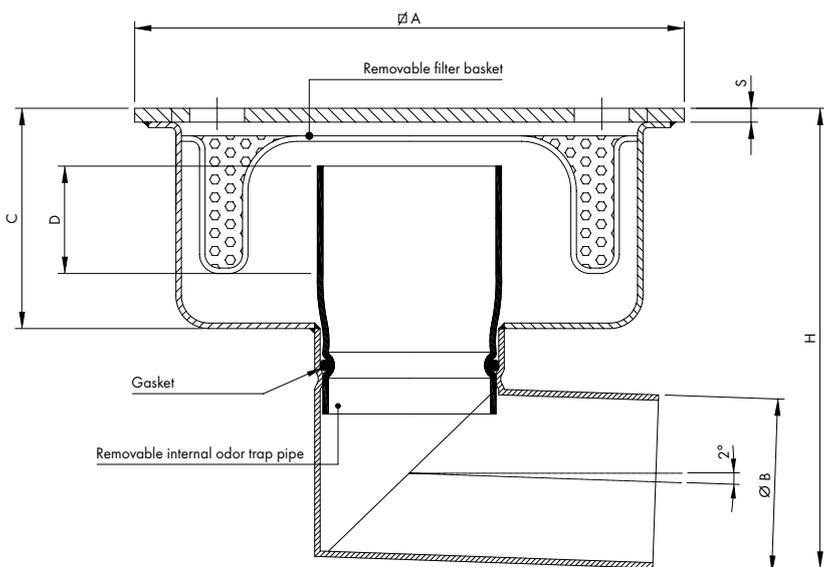

Dwg. No. 0016

| Article | DIMENSIONS in mm | | | | | | FLOW RATE | | LOAD CAPACITY IN Kg | |
|---------------|------------------|---|------|-----|----|-----|-----------|-------------|---------------------|-------|
| | Ø A | S | Ø B* | C | D | H | with Kit | without kit | LOAD | LOAD |
| R-low profile | | | | | | | | | | |
| R 75 L 206 E | 200 | 6 | 75 | 70 | 20 | 180 | 60 | 120 | 1000 | 10000 |
| 75 L 206 E | 200 | 6 | 75 | 110 | 50 | 220 | 60 | 120 | 1000 | 10000 |
| R 75 L 308 E | 300 | 8 | 75 | 65 | 20 | 175 | 80 | 240 | 1000 | 10000 |
| 75 L 308 E | 300 | 8 | 75 | 110 | 50 | 220 | 80 | 240 | 1000 | 10000 |
| R 110 L 308 E | 300 | 8 | 110 | 65 | 20 | 220 | 135 | 340 | 1000 | 10000 |
| 110 L 308 E | 300 | 8 | 110 | 110 | 50 | 265 | 135 | 340 | 1000 | 10000 |

* Outlet Ø 63 mm available on request (lower overall installation height).
N.B. water seal depth (dimension D) of 50 mm in compliance with standard UNI EN 1253-1



By removing both filter basket and internal pipe the wastewater flows and the floor drain should be thoroughly cleaned.
It is highly recommended to fill the floor drain with water after cleaning in order to stop smells from coming back up.